
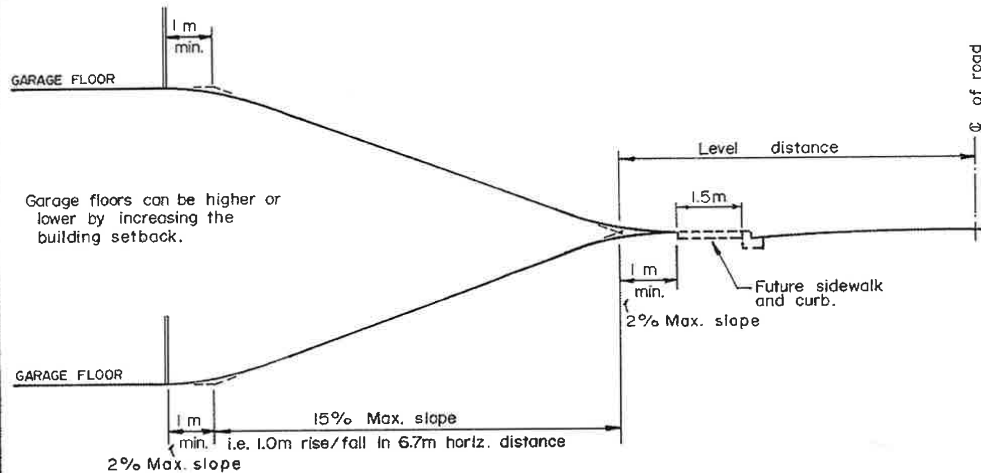


SIDEWALK CROSSINGS

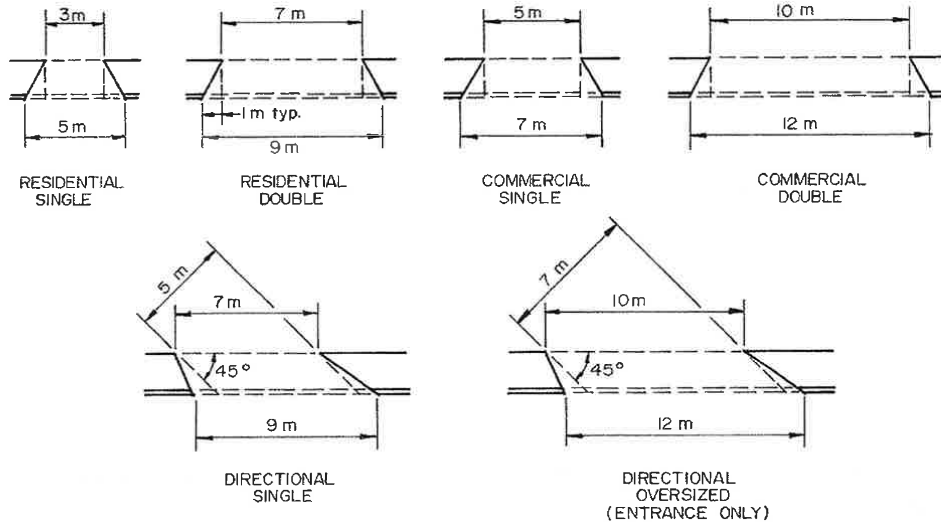

NOTES:

- To allow for future road widening and sidewalk construction, the driveway and finished boulevard grade must be at the same elevation as the center of the existing road surface at the following level distance from the pavement centerline:

	Minimum Level Distance
<input type="checkbox"/> Residential Roads	6.7 m
<input type="checkbox"/> Collector or Arterial Roads	9.1 m

- Where the center of the existing road surface is more than 1.5m off the center of the road allowance, measure the level distance from the center of the road allowance.


THE NEED FOR A DRIVEWAY CULVERT WILL BE AT THE DISCRETION OF THE MUNICIPALITY. CULVERTS WILL BE SIZED AND INSTALLED BY MUNICIPAL FORCES, EXCEPT WHERE THEY ARE REQUIRED SERVICING FOR A DEVELOPMENT OR SUBDIVISION THAT IS UNDER THE DIRECTION OF A PROFESSIONAL ENGINEER.




MUNICIPALITY OF CENTRAL SAANICH

TITLE:	STD.DWG.No.
DRIVEWAY GRADE REQUIREMENTS	513
Approved;	Date: JUNE 1986
Scale: N. T. S.	Rev.

DRIVEWAY CONSTRUCTION FROM CURB

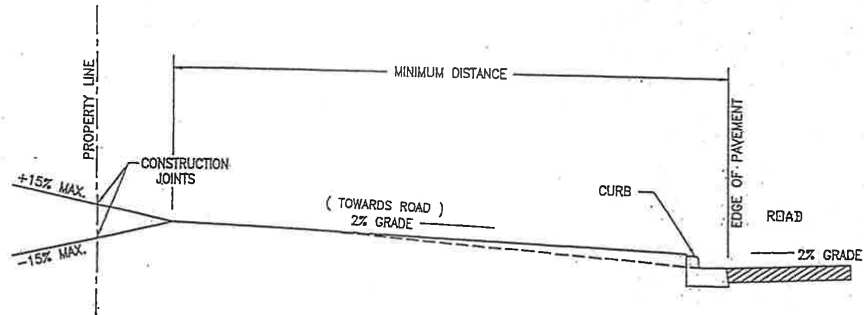

DRIVEWAY AND CULVERT INSTALLATION

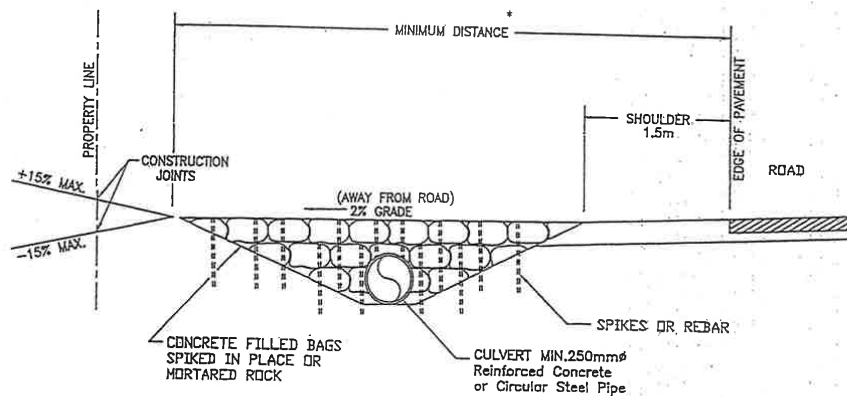

* NOTE

	MINIMUM DISTANCE
- LOCAL ROADS	1.5m (5')
- COLLECTOR ROADS	3.0m (10')
- MAJOR ROADS	TO BE DETERMINED BY MUNICIPAL ENGINEER



MUNICIPALITY OF CENTRAL SAANICH

TITLE:

DRIVEWAY GRADE REQUIREMENTS

APPROVED:

DATE: Mar 2003

SCALE: N.T.S.

STD.DWG.NO.

513

REV.