


BEDDING OF FLEXIBLE PIPE

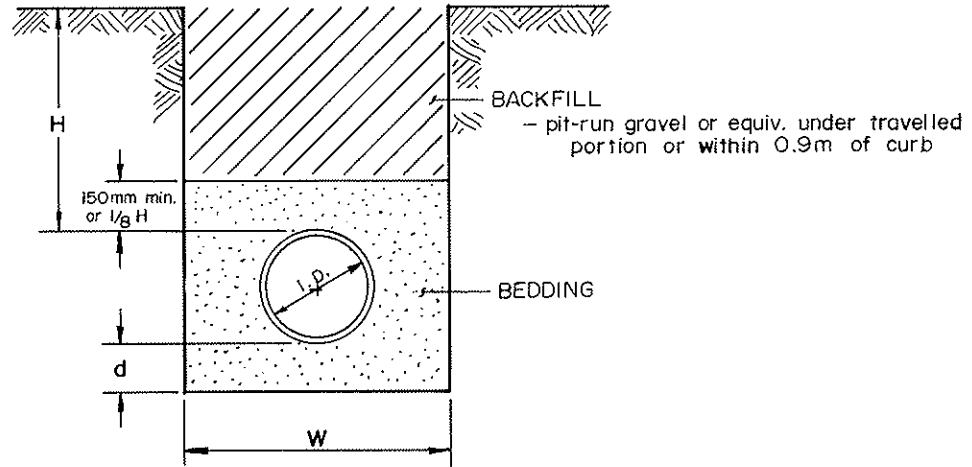


H : 0.75m min. cover . 1.0m min. in road allowances (except c.b. leads) .

d :	I.D. (mm)	d (min.)
	≤ 675	75 mm
	675-1500	100
	> 1500	150


NOTE :

Where trench bottom is rock or other incompressible mat'l, over-excavate a min'm of 150mm and refill with granular mat'l .

W : ≤ 375 mm dia. pipe leave 150-230 mm clear each side of pipe .
 > 375 mm dia. pipe - Trench shall be excavated to the required alignment, WIDTH, depth, and grade as shown on the approved design drawing.

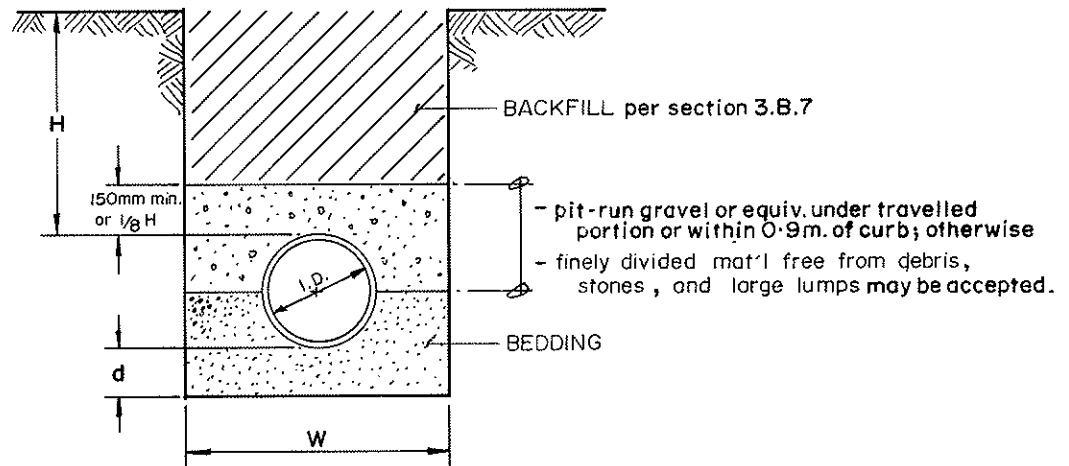

BEDDING OF RIGID PIPE

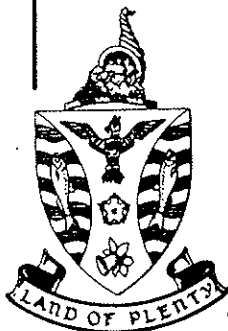

MUNICIPALITY OF CENTRAL SAANICH

TITLE:	PIPE BEDDING	STD.DWG.No. 302
Approved;	Date; JULY 1986	Scale; N.T.S.
		Rev. JUNE 93.