


NOTE :

Consult with Engineering Department where watermain diameter is greater than 300 mm .

Base of Chamber must be Self-Draining

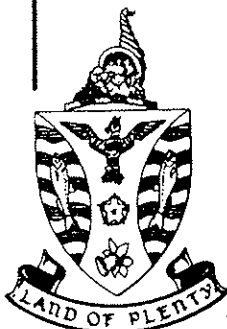

MUNICIPALITY OF CENTRAL SAANICH

TITLE:

AIR VALVE

STD.DWG.No.

404

Approved;

Date; AUG. 1986

Scale; N.T.S.

Rev.