

PREFERRED SERVICE LOCATIONS SHOWN IN DRAWING

ALL SERVICES

- MUST BE 1.0m CLEAR OF LAMP STANDARD BASES AND UTILITY POLES


- MUST BE 1.5m CLEAR OF UNDERGROUND HYDRO

WATER

- MUST BE 3.0m CLEAR OF SEWER & DRAIN

HYDRANTS

- MUST BE 0.75m CLEAR OF PROPERTY LINES OR OBSTRUCTIONS.

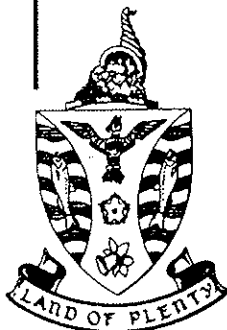

## MUNICIPALITY OF CENTRAL SAANICH

TITLE:

**TYPICAL SERVICE LOCATIONS**

STD. DWG. No.

502

Approved;

Date: JUNE 1986

Scale: N.T.S.

Rev. 02/03