


**NOTES:**

1. RAILS to be 38mm dia. (nom'l) standard galvanized pipe.
2. POSTS to be 38 mm dia. (nom'l) extra strong galvanized pipe.
3. All joints to be welded all around and coated with Galvacon or acceptable equivalent.
4. SLEEVES to be 50mm dia. galvanized iron.
- \* 5. Measurement from top of sidewalk or top of retaining wall where no sidewalk exists.

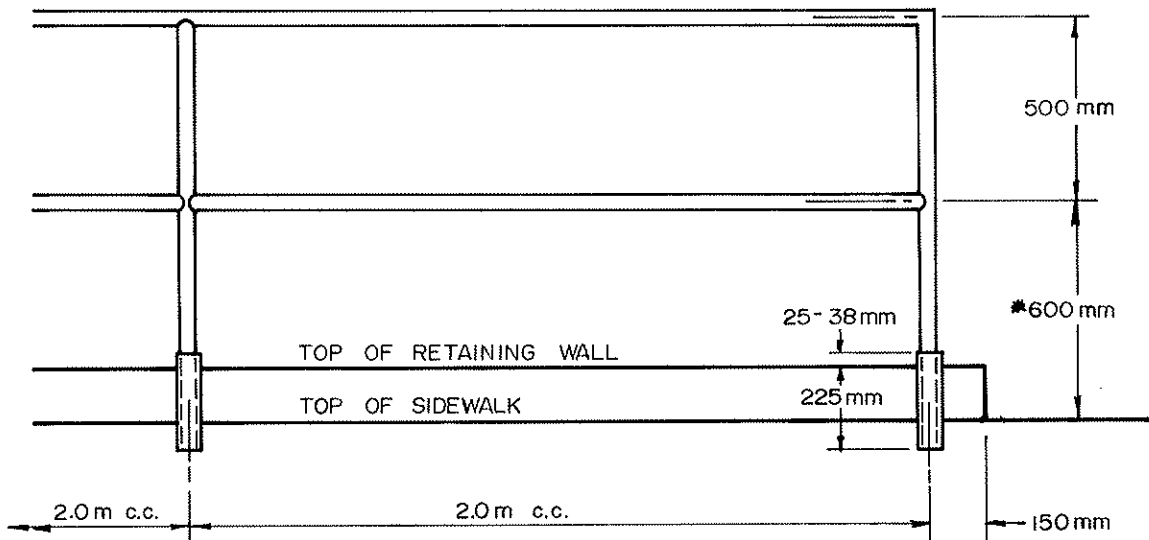

**MUNICIPALITY OF CENTRAL SAANICH**

TITLE:

**SIDEWALK HANDRAILS**

STD.DWG.No.

**518**

Approved;

Date; JUNE 1986

Scale; N.T.S.

Rev.