


NOTES:

1. BOLT SPACING TO BE CHECKED AGAINST MANUFACTURER'S SPECIFICATION.
2. A SWAGED TIP MAY BE SUBSTITUTED FOR THE PIPE INSERT PROVIDED DIMENSIONS AND ALIGNMENT ARE RETAINED.
3. BASE PLATE AND PIPE INSERT TO BE TRUE AND PLUMB.
4. ALL PARTS TO HAVE GALVANIZED FINISH.
5. TO BE SUPPLIED COMPLETE WITH HANHOLE COVER AND BOLT, NUT COVERS, SHIMS, AND WASHERS.
6. LUMINAIRE REFRACTOR TO BE WESTINGHOUSE TYPE II, III, OR IV OR APPROVED EQUIVALENT.

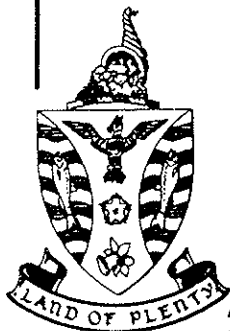

MUNICIPALITY OF CENTRAL SAANICH

TITLE:	POST TOP LUMINAIRE	STD. DWG. No. 602
Approved;	Date; SEPT. 1986	Scale; N. T. S.
		Rev.